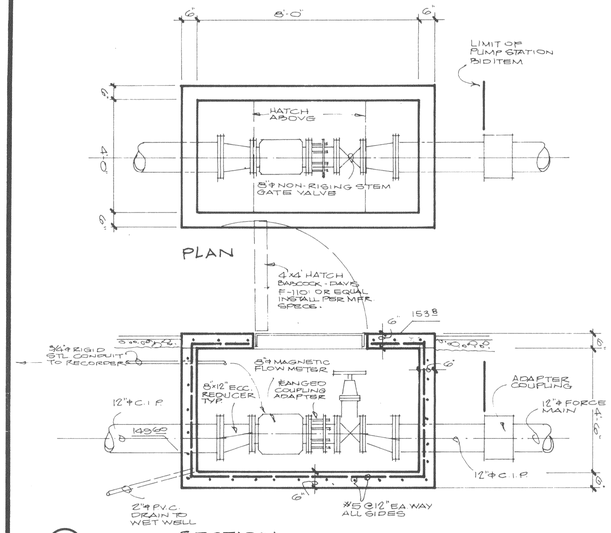

A/17 FLOW METER VAULT

3/8" = 1'-0"

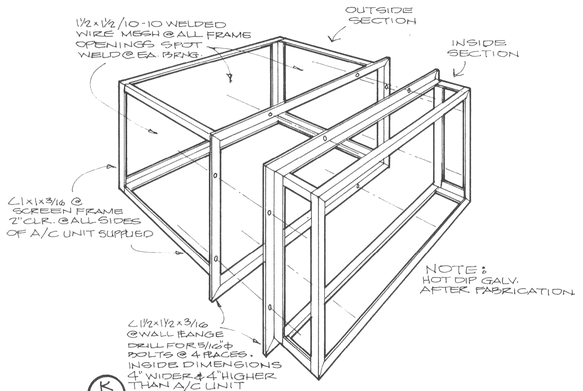

K/17 AIR CONDITIONER VANDAL SCREEN

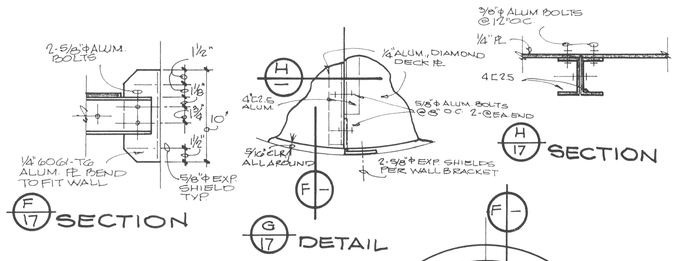

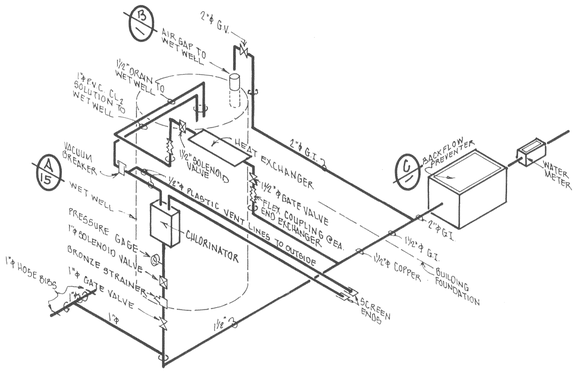

WATER PIPING SCHEMATIC

N.T.S.

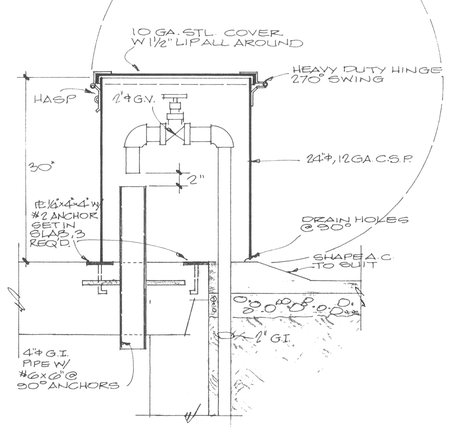

B/17 AIR GAP COVER DET.

1" = 1'-0"

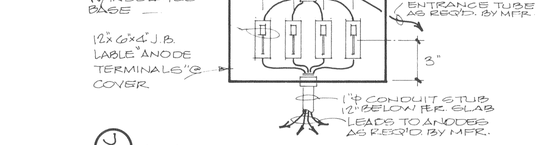

J/17 ANODE TERMINAL BOX

N.T.S.

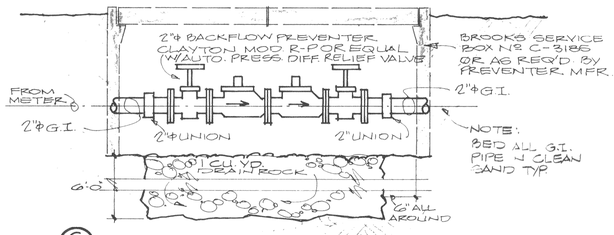

C/17 BACKFLOW PREVENTER

1" = 1'-0"

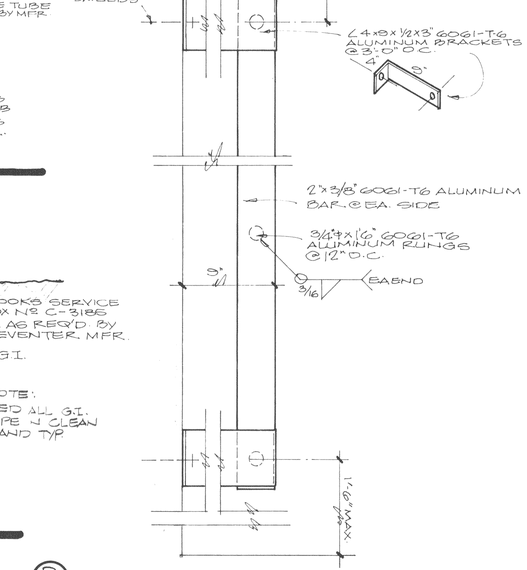

D/17 WET WELL LADDER DET.

1½" = 1'-0"

RINGEL & ASSOCIATES, INC	DES. EAR.						DETAIL SHEET	SEWERAGE COMMISSION, OROVILLE REGION OROVILLE, CALIFORNIA	FEATHER RIVER PUMPING STATION SC - OR WEST INTERCEPTOR	SHEET 17 OF 20
	DR. DH									DATE AUG. 1, 1974
	CHK. WJK									PROJ. NO. 2316
	APPD. [signature]	NO.	DATE	REVISION	BY	APPD.				

277

SS - ~~287~~